
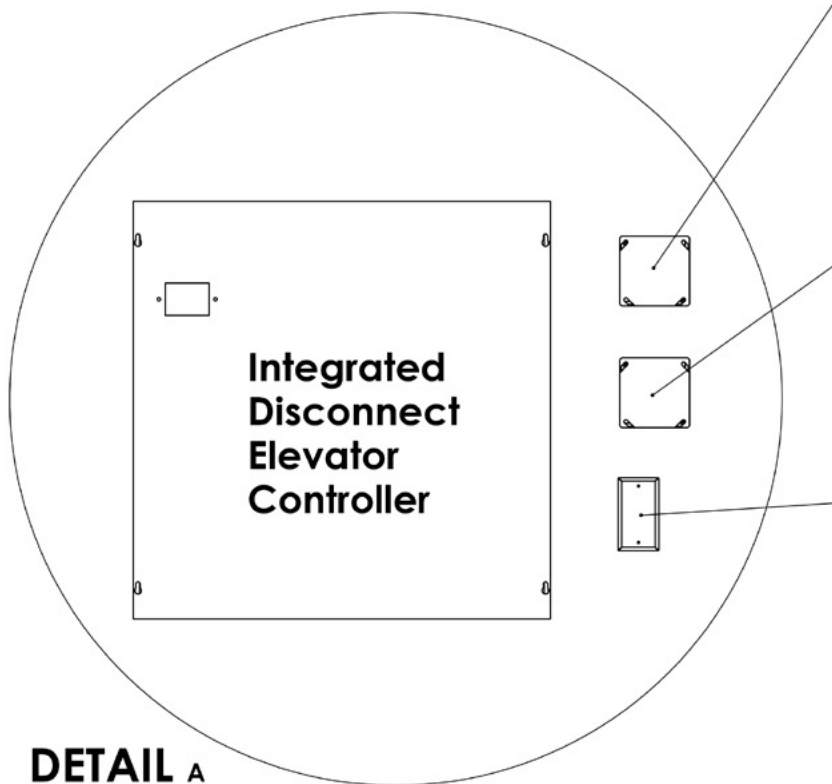


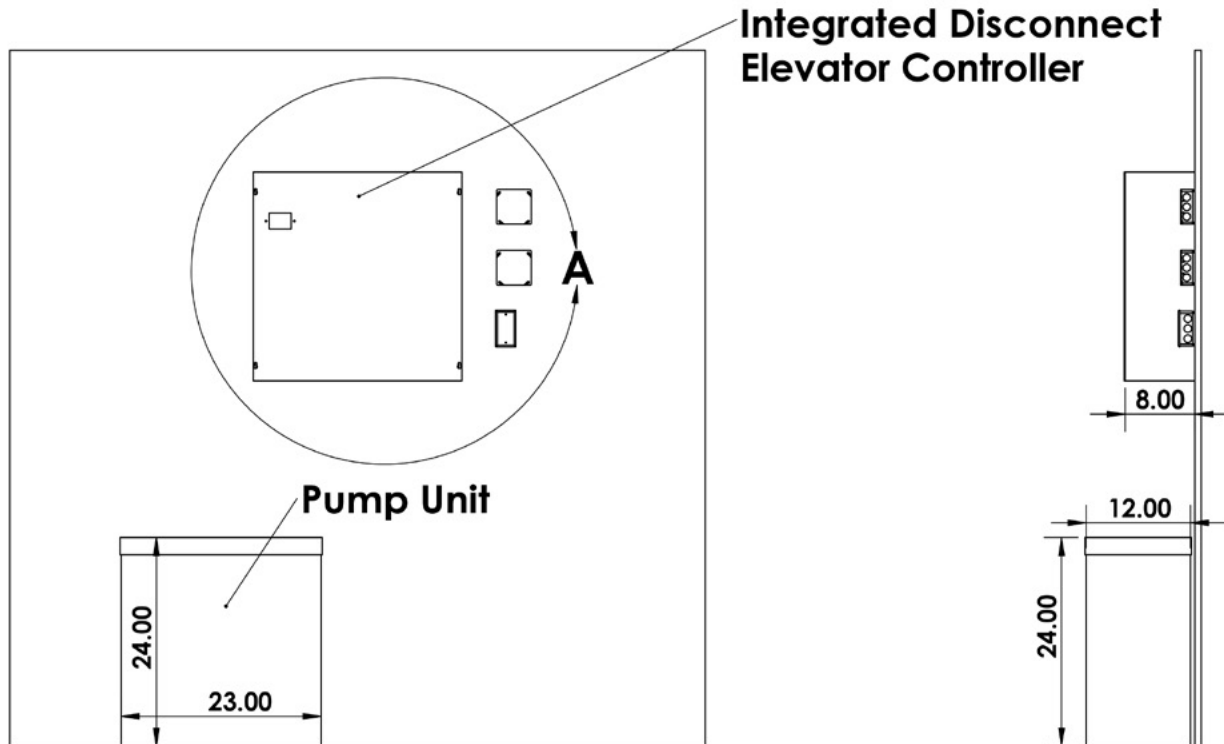

BY OTHERS: 240 vac 30 amp dedicated service with neutral must be provided at a junction box adjacent to the equipment location.
(10-3 Conductor)

BY OTHERS: 120 vac 15 amp dedicated service must be provided at a junction box adjacent to the equipment location.
(12-2 Conductor)

BY OTHERS: Live analog phone signal at a junction box or MyLinkLine Cellular modem required prior to leaving elevator operational.

DETAIL A